

RobustLine damper actuator for adjusting dampers in HVAC plants, comparable industrial plants and technical building installations

- Air damper size up to approx. 2 m²
- Torque motor 10 Nm
- Nominal voltage AC 100...240 V
- Control Open/close, 3-point
- with integrated auxiliary switch
- Optimum protection against corrosion and chemical influences, UV radiation, damp and condensation



Technical data

F	lectri	ادعا	Ы	at:
	ecu	La	u	au

Nominal voltage	AC 100240 V
Nominal voltage frequency	50/60 Hz
Nominal voltage range	AC 85265 V
Power consumption in operation	2.5 W
Power consumption in rest position	0.6 W
Power consumption for wire sizing	5.5 VA
Auxiliary switch	1 x SPDT, 0100%
Switching capacity auxiliary switch	1 mA3 A (0.5 A inductive), DC 5 VAC 250 V
Connection supply / control	Cable 1 m, 3 x 0.75 mm² (halogen-free)
Connection auxiliary switch Cable 1 m, 3 x 0.75 mm² (halogen-free	
Parallel operation	Yes (note the performance data)

Functional data

Torque motor	10 Nm
Direction of motion motor	selectable with switch 0 (ccw rotation) / 1 (cw rotation)
Manual override	with push-button, can be locked
Angle of rotation	Max. 95°
Angle of rotation note	can be limited on both sides with adjustable mechanical end stops
Running time motor	150 s / 90°
Sound power level, motor	35 dB(A)
Mechanical interface Universal shaft clamp 1020 mm	
osition indication Mechanical, pluggable	
Protection class IEC/EN	II, reinforced insulation

Safety data

	. 1 33
Protection class IEC/EN	II, reinforced insulation
Protection class UL	II, reinforced insulation
Protection class auxiliary switch IEC/EN	II, reinforced insulation
Degree of protection IEC/EN	IP66/67
Degree of protection NEMA/UL	NEMA 4X
Enclosure	UL Enclosure Type 4X
EMC	CE according to 2014/30/EU
Low voltage directive	CE according to 2014/35/EU
Certification IEC/EN	IEC/EN 60730-1 and IEC/EN 60730-2-14
UL Approval	cULus according to UL60730-1A, UL60730-2-14 and CAN/CSA E60730-1 The UL marking on the actuator depends on the production site, the device is UL-compliant in any case
Type of action	Type 1.B
Rated impulse voltage supply / control	2.5 kV
Rated impulse voltage auxiliary switch	2.5 kV
Pollution degree	4



Technical data sheet		NM230P-S
Ambient humidity	Max. 100% RH	
Amhient temperature	-30 50°C [-22 122°F]	

Ambient temperature	-3050°C [-22122°F]	
Storage temperature	-4080°C [-40176°F]	
Servicing	maintenance-free	
Weight	1.7 kg	

Weight Weight

Safety notes



Safety data

- This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- · Caution: Power supply voltage!
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.
- Junction boxes must at least correspond with enclosure IP degree of protection!
- The cover of the protective housing may be opened for adjustment and servicing. When it is closed afterwards, the housing must seal tight (see installation instructions).
- The device may only be opened at the manufacturer's site. It does not contain any parts that can be replaced or repaired by the user.
- The cables must not be removed from the device installed in the interior.
- To calculate the torque required, the specifications supplied by the damper manufacturers concerning the cross-section, the design, the installation situation and the ventilation conditions must be observed.
- The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.
- The information on chemical resistance refers to laboratory tests with raw materials and finished products and to trials in the field in the areas of application indicated.
- The materials used may be subjected to external influences (temperature, pressure, constructional fixture, effect of chemical substances, etc.), which cannot be simulated in laboratory tests or field trials.
- The information regarding areas of application and resistance can therefore only serve as a guideline. In case of doubt, we definitely recommend that you carry out a test. This information does not imply any legal entitlement. Belimo will not be held liable and will provide no warranty. The chemical or mechanical resistance of the materials used is not alone sufficient for judging the suitability of a product. Regulations pertaining to combustible liquids such as solvents etc. must be taken into account with special reference to explosion protection.
- Flexible metallic cable conduits or threaded cable conduits of equal value are to be used for UL (NEMA) Type 4X applications.
- When used under high UV loads, e.g. extreme sunlight, the use of flexible metallic or equivalent cable conduits is recommended.

Product features

Fields of application

The actuator is particularly suitable for utilisation in outdoor applications and is protected against the following weather conditions:

- Wood drying
- Animal breeding
- Food processing
- Agriculture
- Indoor swimming pools / bathhouses
- Rooftop ventilation plant rooms
- General outdoor applications
- Alternating climate
- Laboratories

Resistances Noxious gas test EN 60068-2-60 (Fraunhofer Institut ICT / DE)

Salt fog spray test EN 60068-2-52 (Fraunhofer Institut ICT / DE) Ammoniac test DIN 50916-2 (Fraunhofer Institut ICT / DE) Climate test IEC60068-2-30 (Trikon Solutions AG / CH) Disinfectant (animals) (Trikon Solutions AG / CH)

UV Test (Solar radiation at ground level) EN 60068-2-5, EN 60068-2-63 (Quinel / Zug CH)

Used materials Actuator housing polypropylene (PP)

Cable glands / hollow shaft polyamide (PA)

Connecting cable FRNC

Clamp / screws in general Steel 1.4404

Seals EPDM

Form fit insert aluminium anodised

Simple direct mounting Simple direct mounting on the damper shaft with a universal shaft clamp, supplied with an anti-

rotation device to prevent the actuator from rotating.

Manual override Manual override with push-button possible (the gear train is disengaged for as long as the

button is pressed or remains locked).

Adjustable angle of rotation Adjustable angle of rotation with mechanical end stops. Standard setting 0...90°. The housing

cover must be removed to set the angle of rotation.

High functional reliability The actuator is overload protected, requires no limit switches and automatically stops when the

end stop is reached.

Flexible signalling With adjustable auxiliary switch (0...100%)

The housing cover must be removed to set the auxiliary switch.

Electrical installation



Caution: Power supply voltage!

Parallel connection of other actuators possible. Observe the performance data.

Wire colours:

1 = blue

2 = brown

3 = white


S1 = white


S2 = white


S3 = white

Wiring diagrams

AC 230 V, open/close












Operating controls and indicators

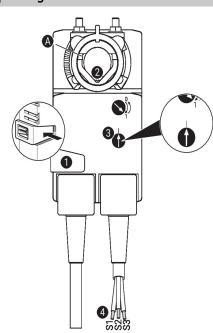

Auxiliary switch settings

<u>^</u>

Note: Perform settings on the actuator only in deenergised state.

For the auxiliary switch position settings, carry out points 1 to 4 successively.

Manual override button

Holding button pressed down: Gear train disengages. Manual override is possible.

2 Shaft clamp

Turn until edge line (A) displays the desired switching position of the actuator and release button (1).

3 Auxiliary switch

Turn rotary knob until the arrow points to the vertical line.


4 Cable

Connect continuity tester to S1 + S2 or to S1 + S3.

If the auxiliary switch should switch in the opposite direction, rotate the auxiliary switch by 180°.


Dimensions

Spindle length





Clamping range


OŢ.		◆ I
1020	814	1020

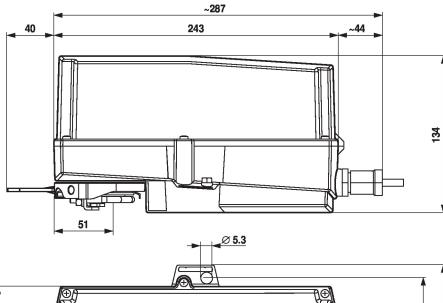





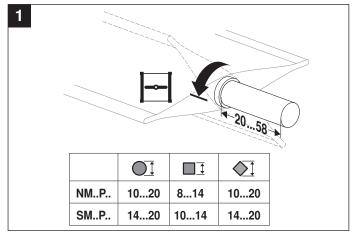


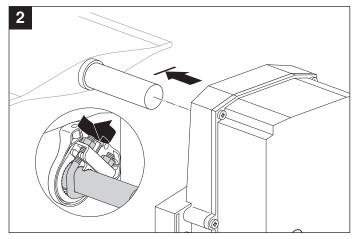

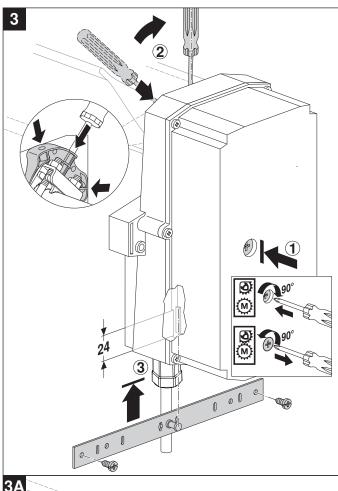

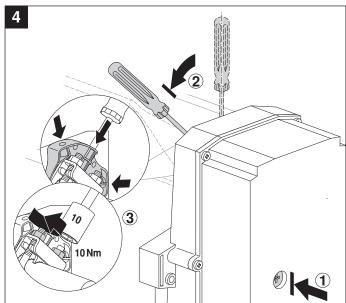

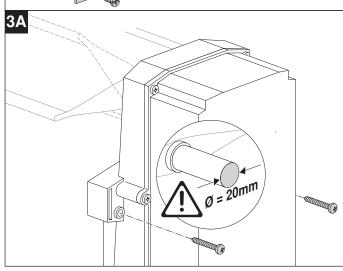


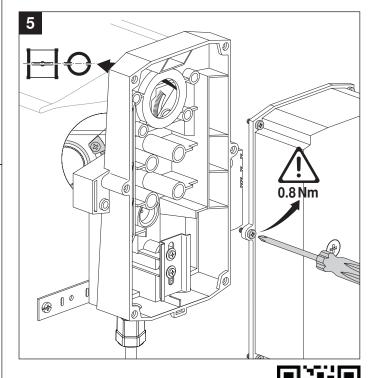


www.belimo.com/safety






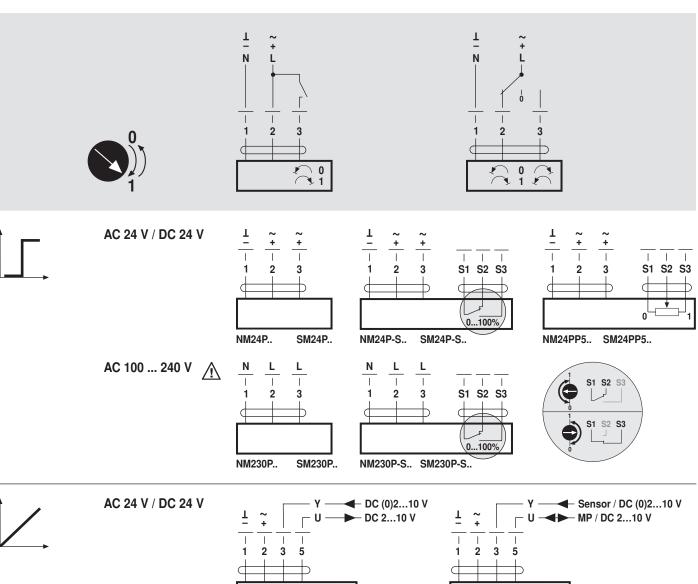






NM24P-SR.. SM24P-SR.. NM24P-MF.. SM24P-MF..







SALES CONTACT



www.airmax-hvac.com



080-614-4944, 063-268-8080



@airmax (Line Official)



windcontrol.info@gmail.com



Address
เลขที่ 56/392 หมู่ที่ 12
ตำบลศีรษะจรเข้น้อย
อำเภอบางเสาธง
จังหวัดสมุทรปราการ
10540

