

Rotary actuator fail-safe for adjusting dampers in technical building installations

- Air damper size up to approx. 2 m²
- Torque motor 10 Nm
- Nominal voltage AC 24...240 V / DC 24...125 V
- Control Open/close
- with 2 integrated auxiliary switches
- Optimum weather protection for use outdoors



Technical data

-				
	ectri	rai	~ ~ ~	Ta.

Nominal voltage	AC 24240 V / DC 24125 V
Nominal voltage frequency	50/60 Hz
Nominal voltage range	AC 19.2264 V / DC 21.6137.5 V
Power consumption in operation	6 W
Power consumption in rest position	2.5 W
Power consumption for wire sizing	9.5 VA
Auxiliary switch	2 x SPDT, 1 x 10% / 1 x 11100%
Switching capacity auxiliary switch	1 mA3 A (0.5 A inductive), DC 5 VAC 250 V
Connection supply / control	Cable 1 m, 2 x 0.75 mm² (halogen-free)
Connection auxiliary switch	Cable 1 m, 6 x 0.75 mm² (halogen-free)
Parallel operation	Yes (note the performance data)

Functional data

Torque motor	10 Nm
Torque fail-safe	10 Nm
Direction of motion fail-safe	L (ccw)
Manual override	by means of hand crank and locking switch
Angle of rotation	Max. 95°
Angle of rotation note	adjustable starting at 33% in 2.5% steps (with mechanical end stop)
Running time motor	75 s / 90°
Running time fail-safe	<20 s @ -2050°C / <60 s @ -30°C
Sound power level, motor	45 dB(A)
Mechanical interface	Universal shaft clamp 1226.7 mm
Position indication	Mechanical, pluggable
Service life	Min. 60'000 fail-safe positions
Protection class IEC/EN	II_reinforced insulation

Safety data

Protection class IEC/EN	II, reinforced insulation
Protection class UL	II, reinforced insulation
Protection class auxiliary switch IEC/EN	II, reinforced insulation
Degree of protection IEC/EN	IP66/67
Degree of protection NEMA/UL	NEMA 4X
Enclosure	UL Enclosure Type 4X
EMC	CE according to 2014/30/EU
Low voltage directive	CE according to 2014/35/EU
Certification IEC/EN	IEC/EN 60730-1 and IEC/EN 60730-2-14
UL Approval	cULus according to UL60730-1A, UL60730-2-14
	and CAN/CSA E60730-1
	The UL marking on the actuator depends on
	the production site, the device is UL-compliant
	in any case
Type of action	Type 1.AA.B
Rated impulse voltage supply / control	4 kV



	Technical data sheet		NFG-S2-L
afety data	Rated impulse voltage auxiliary switch	2.5 kV	
	Pollution degree	4	
	Ambient humidity	Max. 100% RH	
	Ambient temperature	-3050°C [-22122°F]	
	Storage temperature	-4080°C [-40176°F]	
	Servicing	maintenance-free	
Weight	Weight	4.4 kg	

Safety notes



Sa

- This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- Caution: Power supply voltage!
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.
- Junction boxes must at least correspond with enclosure IP degree of protection!
- The cover of the protective housing may be opened for adjustment and servicing. When it is closed afterwards, the housing must seal tight (see installation instructions).
- The device may only be opened at the manufacturer's site. It does not contain any parts that can be replaced or repaired by the user.
- The cables must not be removed from the device installed in the interior.
- To calculate the torque required, the specifications supplied by the damper manufacturers concerning the cross-section, the design, the installation situation and the ventilation conditions must be observed.
- The two switches integrated in the actuator are to be operated either on power supply voltage
 or at safety extra-low voltage. The combination power supply voltage/safety extra-low voltage
 is not permitted.
- The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.
- The device is not designed for applications where chemical influences (gases, fluids) are present or for utilisation in corrosive environments in general.
- The actuator may not be used in plenary applications (e.g. suspended ceilings or raised floors).
- The materials used may be subject to external influences (temperature, pressure, construction
 fastening, effect of chemical substances, etc.), which cannot be simulated in laboratory tests
 or field trials. In case of doubt, we definitely recommend that you carry out a test. This
 information does not imply any legal entitlement. Belimo will not be held liable and will
 provide no warranty.
- Flexible metallic cable conduits or threaded cable conduits of equal value are to be used for UL (NEMA) Type 4X applications.
- When used under high UV loads, e.g. extreme sunlight, the use of flexible metallic or equivalent cable conduits is recommended.

Product features

Fields of application

The actuator is particularly suitable for utilisation in outdoor applications and is protected against the following weather conditions:

- UV radiation
- Rain / Snow
- Dirt / Dust
- Air humidity

Mode of operation

The actuator is equipped with a universal power supply module that can utilise supply voltages of AC 24...240 V and DC 24...125V.

The actuator moves the damper to the operating position at the same time as tensioning the return spring. The damper is turned back to the fail-safe position by spring force when the supply voltage is interrupted.

Simple direct mounting

Simple direct mounting on the damper shaft with a universal shaft clamp, supplied with an antirotation device to prevent the actuator from rotating.



Technical data sheet

NFG-S2-L

Manual override By using

By using the hand crank the damper can be actuated manually and engaged with the locking switch at any position. Unlocking is carried out manually or automatically by applying the

operating voltage.

The housing cover must be removed for manual override.

Adjustable angle of rotation

Adjustable angle of rotation with mechanical end stops.

High functional reliability

The actuator is overload protected, requires no limit switches and automatically stops when the

end stop is reached.

Flexible signalling

The actuator has one auxiliary switch with a fixed setting and one adjustable auxiliary switch.

They permit a 10% or 11...100% angle of rotation to be signaled.

Accessories

Mechanical accessories	Description	Туре
	Cable gland for cable diameter Ø 410 mm	Z-KB-PG11

Electrical installation



Caution: Power supply voltage!

Parallel connection of other actuators possible. Observe the performance data.

Wire colours:

1 = blue

2 = brown

S1 = violet

S2 = red

S3 = white

S4 = orange


S5 = pink

S6 = grey

Wiring diagrams


AC 24...240 V / DC 24...125 V, open/ Auxiliary switch







Operating controls and indicators

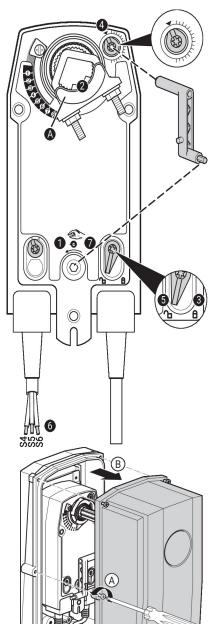

Auxiliary switch settings

1

Note: Perform settings on the actuator only in deenergised state.

For the auxiliary switch position settings, carry out points 1 to 2 successively.

Manual override

Turn the hand crank until the desired switching position is set.

2 Shaft clamp

Edge line A displays the desired switching position of the actuator on the scale.

3 Fasten the locking device

Turn the locking switch to the "Locked padlock" symbol.

4 Auxiliary switch

Turn rotary knob until the notch points to the arrow symbol.

5 Unlock the locking device

Turn the locking switch to the "Unlocked padlock" symbol or unlock with the hand crank.

6 Cable

Connect continuity tester to S4 + S5 or to S4 + S6.


Manual override

Turn the hand crank until the desired switching position is set and check whether the continuity tester shows the switching point.




Dimensions


Spindle length




Clamping range


	OĮ.	_
	1222	1218
	OI.	1
	2226.7	1218

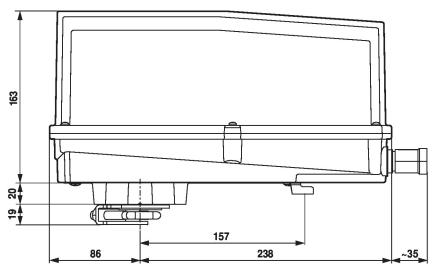


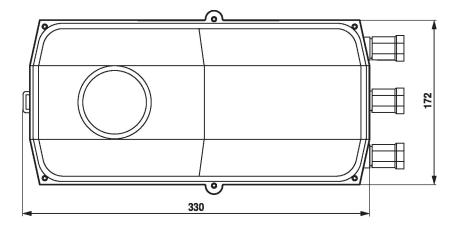




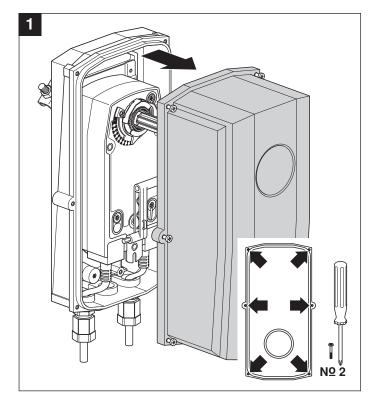

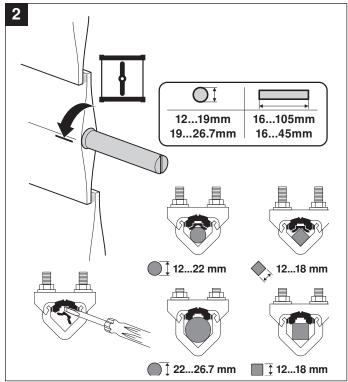


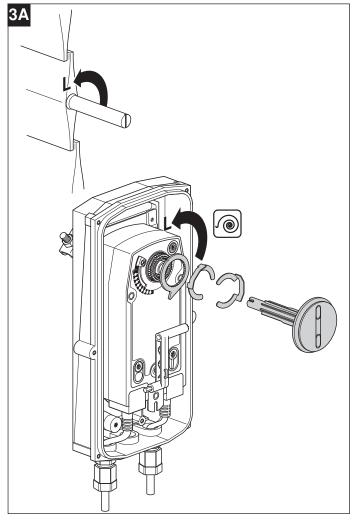


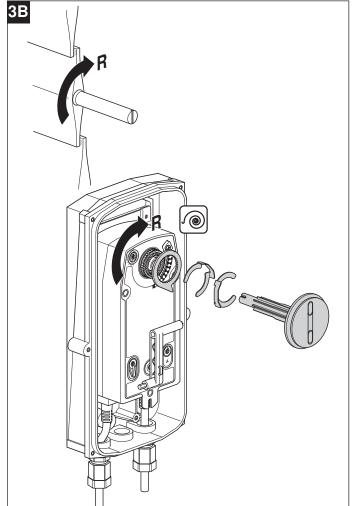








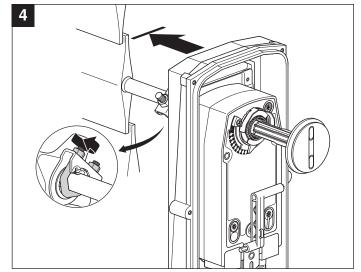


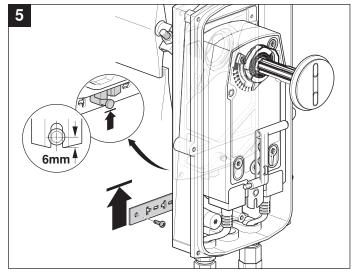

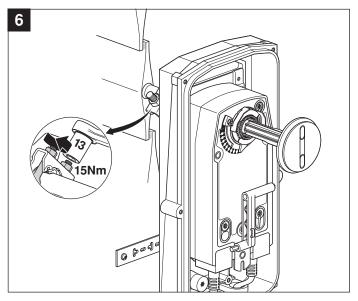


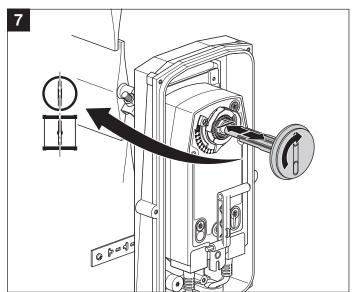

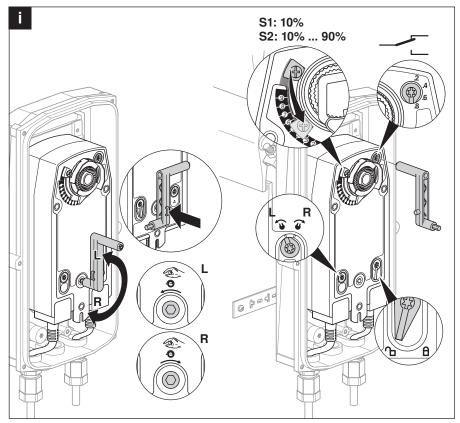


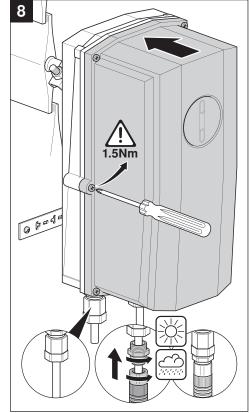




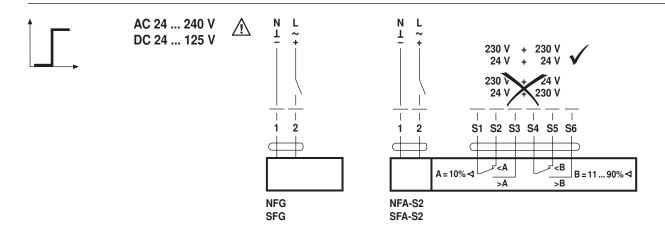

AC 24 V / DC 24 V

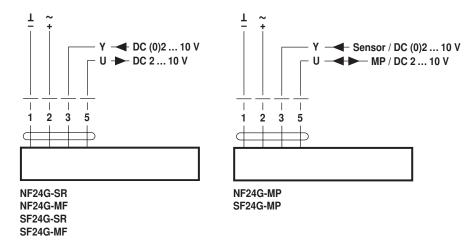



NF24G-SR-S2 SF24G-SR-S2

SALES CONTACT



www.airmax-hvac.com



080-614-4944, 063-268-8080



@airmax (Line Official)



windcontrol.info@gmail.com



Address
เลขที่ 56/392 หมู่ที่ 12
ตำบลศีรษะจรเข้น้อย
อำเภอบางเสาธง
จังหวัดสมุทรปราการ
10540

